

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH100 two-wire system (Pt100)

#### Overview



The SITRANS TH100 dispenses with electrical isolation and universal sensor connection to provide a low-cost alternative for Pt100 measurements.

For the parameterization, the SIPROM T software is used in combination with the modem for SITRANS TH100/TH200.

Its extremely compact design makes the SITRANS TH100 ideal for the retrofitting of measuring points or for the use of analog transmitters.

The transmitter is available as a non-Ex version as well as for use in potentially explosive atmospheres.

#### Benefits

- Two-wire transmitter
- Assembly in connection head type B (DIN 43729) or larger, or on a standard DIN rail
- Can be programmed, which means that the sensor connection, measuring range, etc. can also be programmed
- Intrinsically-safe version for use in potentially explosive areas

#### Application

Used in conjunction with Pt100 resistance thermometers, the SITRANS TH100 transmitters are ideal for measuring temperatures in all industries. Due to its compact size it can be installed in the connection head type B (DIN 43729) or larger.

The output signal is a direct current from 4 to 20 mA that is proportional to the temperature.

Parameterization is implemented over the PC using the parameterization software SIPROM T and the modem for SITRANS TH100/TH200. If you already have a "modem for SITRANS TK" (Article No. 7NG3190-6KB), you can continue using this to parameterize the SITRANS TH100.

Transmitters of the "intrinsically-safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 94/9/EC (ATEX), as well as FM and CSA regulations.


#### Function

##### Mode of operation

The measured signal supplied by a Pt100 resistance thermometer (2, 3 or 4-wire system) is amplified in the input stage. The voltage, which is proportional to the input variable, is then converted into digital signals by a multiplexer in an analog/digital converter. They are converted in the microcontroller in accordance with the sensor characteristics and further parameters (measuring range, damping, ambient temperature etc.).

The signal prepared in this way is converted in a digital/analog converter into a load-independent direct current of 4 to 20 mA.

An EMC filter protects the input and output circuits against electromagnetic interferences.

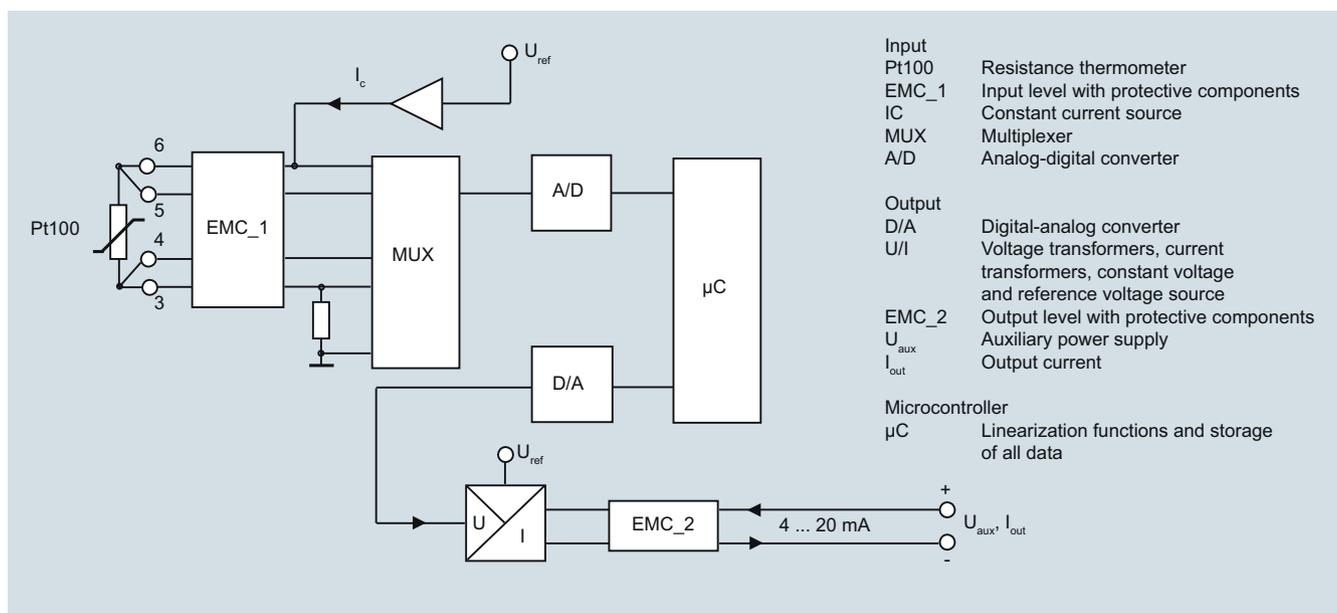

SITRANS TH100, function diagram

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH100 two-wire system (Pt100)

#### Technical specifications

##### Input

Resistance thermometer	
Measured variable	Temperature
Sensor type	PT100 to IEC 60751
Characteristic curve	Temperature-linear
Type of connection	2-, 3- or 4-wire circuit
Resolution	14 bit
Measuring accuracy	
• Span <250 °C (450 °F)	< 0.25 °C (0.45 °F)
• Span >250 °C (450 °F)	< 0.1 % of span
Repeatability	< 0.1 °C (0.18 °F)
Measuring current	approx. 0.4 mA
Measuring cycle	< 0.7 s
Measuring range	-200 ... +850 °C -328 ... +1562 °F)
Measuring span	25 ... 1050 °C (77 ... 1922 °F)
Unit	°C or °F
Offset	programmable: -100 ... +100 °C (-180 ... +180 °F)
Line resistance	Max. 20 Ω (total from feeder and return conductor)
Noise rejection	50 and 60 Hz

##### Output

Output signal	4 ... 20 mA, two-wire
Auxiliary power	8.5 ... 36 V DC (30 V for Ex ia and ib; 32 V for Ex nL/ic; 35 V for Ex nA)
Max. load	$(U_{aux} - 8.5 \text{ V})/0.023 \text{ A}$
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.84 ... 20.5 mA)
Error signal (following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default range: 3.6 mA or 22.8 mA)
Damping time	0 ... 30 s (default value: 0 s)
Protection	Against reversed polarity
Resolution	12 bit
Accuracy at 23 °C (73.4 °F)	< 0.1 % of span
Temperature effect	< 0.1 %/10 °C (0.1 %/18 °F)
Effect of auxiliary power	< 0.01 % of span/V
Effect of load impedance	< 0.025 % of max. span/100 Ω
Long-term drift	<ul style="list-style-type: none"> <li>&lt; 0.025 % of the max. span in the first month</li> <li>&lt; 0.035 % of the max. span after one year</li> <li>&lt; 0.05 % of the max. span after 5 years</li> </ul>

##### Ambient conditions

Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)
Relative humidity	98 %, with condensation
Electromagnetic compatibility	According to EN 61326 and NAMUR NE21

##### Construction

Weight	50 g
Dimensions	See dimensional drawing
Material	Molded plastic
Cross-section of cables	Max. 2.5 mm <sup>2</sup> (AWG 13)
Degree of protection to IEC 60529	
• Enclosure	IP40
• Terminals	IP00

#### Certificates and approvals

Explosion protection ATEX

EC type test certificate

• "Intrinsic gas safety" type of protection

• "Non-sparking" type of protection

• "Intrinsic dust safety" type of protection

Explosion protection FM for USA and Canada (<sub>c</sub>FM<sub>US</sub>)

• FM approval

• Degree of protection

Other certificates

#### Software requirements for SIPROM T

PC operating system

PTB 05 ATEX 2049X

II 1 G Ex ia IIC T6/T4

II (1) 2 G Ex ib [ia Ga] IIC T6/T4 Gb

II (1) 3 G Ex ic [ia Ga] IIC T6/T4 Gc

II 3 G Ex ic IIC T6/T4 Gc

II 3 G Ex nA IIC T6/T4 Gc

II 3 G Ex nA[ic] IIC T6/T4 Gc

II 1 D Ex ia IIIC T115 °C Da

PID 3024169

IS CI I, II, III, Div 1, GP ABCDEFG

T4/T5/T6

CI I, ZN 0,1 AEx ia IIC T4/T5/T6

NI CI I, II, III, Div 2, GP ABCDFG

T4/T5/T6

CI I, ZN 2, NI IIC T4/T5/T6

GOST, NEPSI, PESO

Windows ME, 2000, XP, Win 7 and Win 8; can also be used in connection with RS 232 modem under Windows 95, 98 and 98SE

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH100 two-wire system (Pt100)

#### Selection and Ordering data

Article No.

#### SITRANS TH100 temperature transmitters for Pt100

for installation in connection head, type B (DIN 43729), two-wire system, 4 ... 20 mA, programmable, without electrical isolation

- Without explosion protection ▶ ◆ **7NG3211-0NN00**
- With explosion protection "Intrinsic safety" type of protection and for zone 2
  - to ATEX ▶ ◆ **7NG3211-0AN00**
  - to FM (cFMUS) ▶ ◆ **7NG3211-0BN00**

#### Further designs

Order code

Add **"-Z"** to Article No. and specify Order code(s)

Test report (5 measuring points)

**C11**

#### Customer-specific programming

Add **"-Z"** to Article No. and specify Order code(s)

Measuring range to be set

Specify in plain text (max. 5 digits):

Y01: ... to ... °C, °F

**Y01<sup>1)</sup>**

Measuring point no. (TAG), max. 8 characters

**Y17<sup>2)</sup>**

Measuring point descriptor, max. 16 characters

**Y23<sup>2)</sup>**Pt100 (IEC) 2-wire,  $R_L = 0 \Omega$ **U02<sup>3)</sup>**

Pt100 (IEC) 3-wire

**U03<sup>3)</sup>**

Pt100 (IEC) 4-wire

**U04<sup>3)</sup>**

Special differing customer-specific programming, specify in plain text

**Y09<sup>4)</sup>**

Fail-safe value 3.6 mA (instead of 22,8 mA)

**U36<sup>2)</sup>**

#### Accessories

Article No.

**Modem for SITRANS TH100, TH200, TR200 and TF with TH200 incl. SIPROM T parameterization software** ▶

With USB connection

**7NG3092-8KU**

**MiniDVD for temperature measuring instruments** ▶

With documentation in German, English, French, Spanish, Italian, Portuguese and SIPROM T parameterization software

**A5E00364512**

**DIN rail adapters for head transmitters** ▶

(Quantity delivered: 5 units)

**7NG3092-8KA**

#### Connecting cable

4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)

**7NG3092-8KC**

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 9/5 in the appendix.

- 1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- 2) For this selection, Y01 or Y09 must also be selected.
- 3) For this selection, Y01 must also be selected.
- 4) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

#### Ordering example

7NG3211-0NN00-Z Y01+Y23+U03


Y01: -10 ... +100 °C

Y23: TICA1234HEAT

#### Factory setting:


- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °C)
- Error signal in the event of sensor breakage: 22.8 mA
- Sensor offset: 0 C (0 °F)
- Damping 0.0 s

#### Dimensional drawings

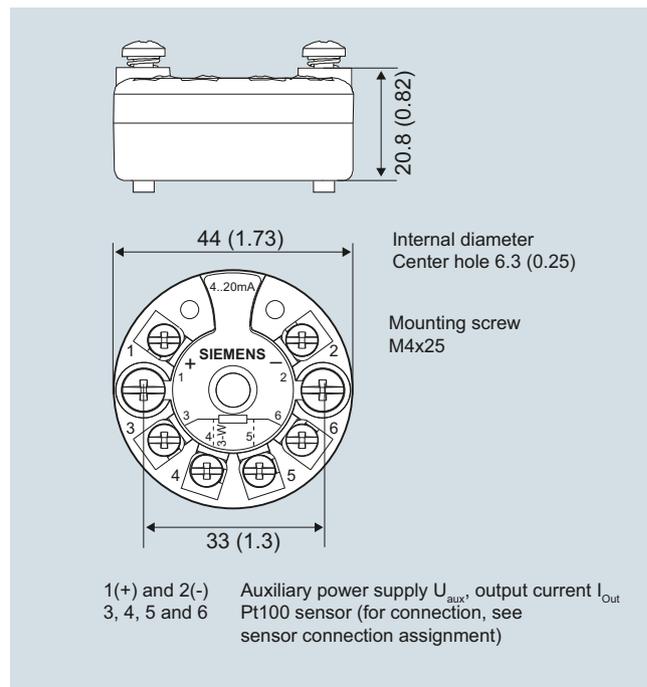


SITRANS TH100, dimensions in mm (inch)

#### Mounting on DIN rail

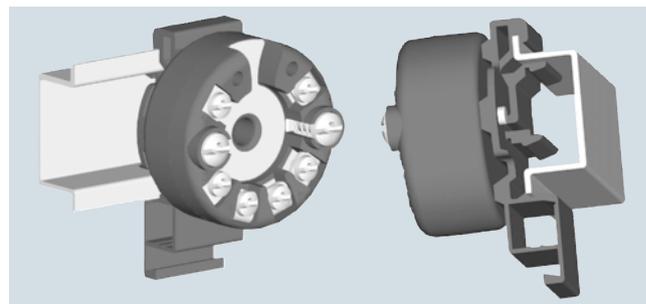

SITRANS TH100, mounting of transmitter on DIN rail

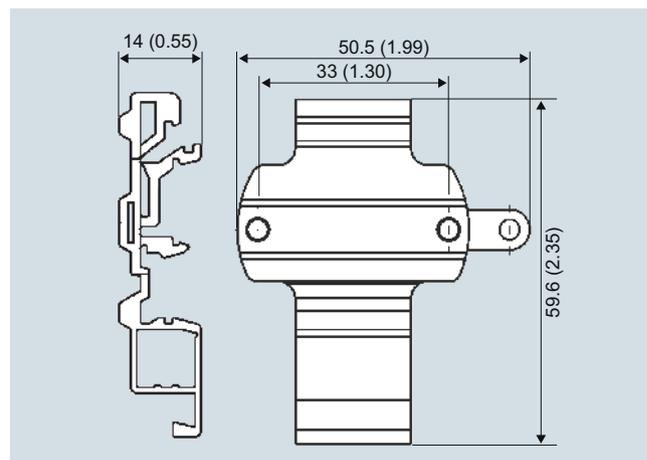


DIN rail adaptor, dimensions in mm (inch)

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH100 two-wire system (Pt100)

#### Schematics

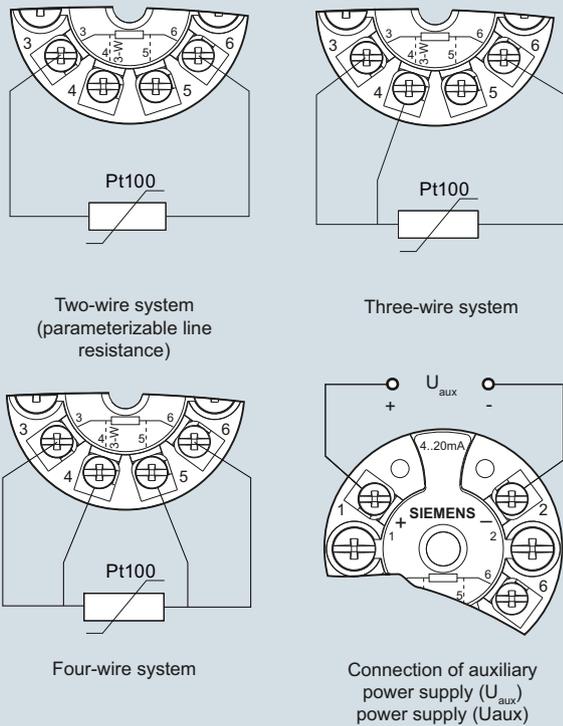

SITRANS TH100, sensor connection assignment

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH200 two-wire system, universal

#### Overview



#### Ultra flexible - with the universal SITRANS TH200 transmitter

- Two-wire devices for 4 to 20 mA
- Mounting in the connection head of the temperature sensor
- Universal input for virtually any type of temperature sensor
- Configurable over PC

#### Benefits

- Compact design
- Flexible mounting and center hole allow you to select your preferred type of installation
- Electrically isolated
- Test sockets for multimeters
- Diagnostics LED (green/red)
- Sensor monitoring open circuits and short-circuits
- Self-monitoring
- Configuration status stored in EEPROM
- SIL2 (with Order Code C20), SIL2/3 (with C23)
- Expanded diagnostic functions, such as slave pointer, operating hours counter, etc.
- Special characteristic
- Electromagnetic compatibility to EN 61326 and NE21

#### Application

SITRANS TH200 transmitters can be used in all industrial sectors. Due to their compact size they can be installed in the connection head type B (DIN 43729) or larger. The following sensors/signal sources can be connected over their universal input module:

- Resistance thermometers (2, 3 or 4-wire system)
- Thermocouples
- Resistance-based sensors and DC voltage sources

The output signal is a direct current from 4 to 20 mA in accordance with the sensor characteristic.


Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 94/9/EC (ATEX), as well as FM and CSA regulations.

#### Function

The SITRANS TH200 is configured over a PC. A USB or RS 232 modem is linked to the output terminals for this purpose. The configuration data can now be edited using the SIPROM T software tool. The configuration data are then permanently stored in the non-volatile memory (EEPROM).

Once the sensors and power supply have been correctly connected, the transmitter outputs a temperature-linear output signal and the diagnostics LED displays a green light. In the case of a sensor short-circuit, the LED flashes red, an internal device fault is indicated by a steady red light.

The test socket can be used to connect an ammeter at any time for monitoring purposes and plausibility checks. The output current can be read without any interruption, or even without opening the current loop.

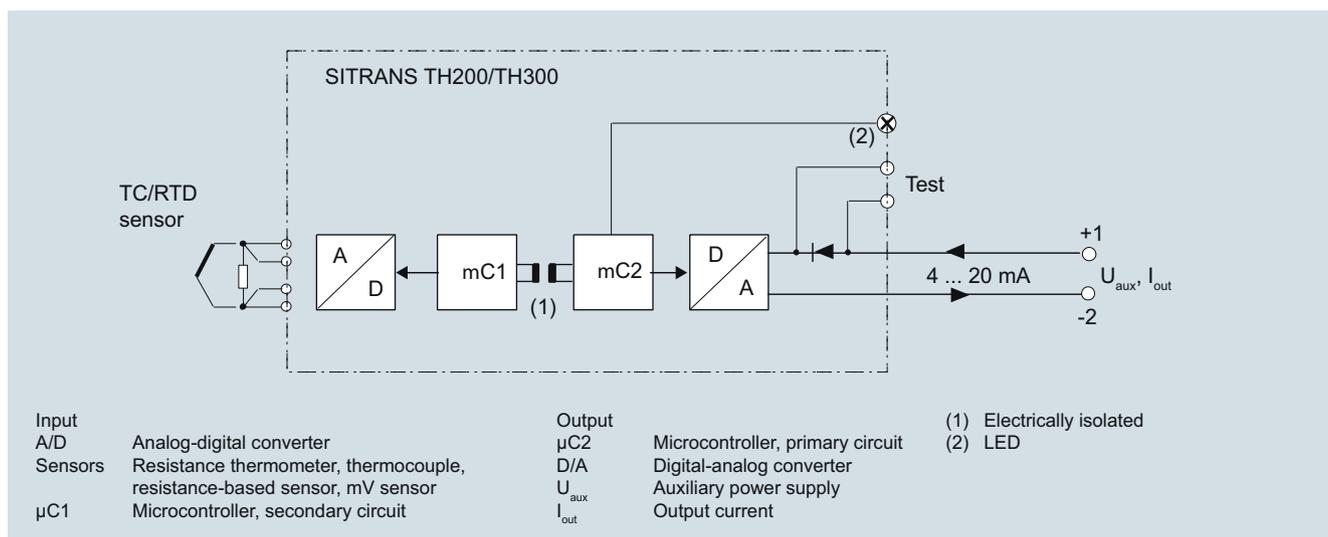

SITRANS TH200 function diagram

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH200 two-wire system, universal

#### Technical specifications

##### Input

##### Resistance thermometer

Measured variable	Temperature
Sensor type	
• to IEC 60751	Pt25 ... Pt1000
• To JIS C 1604; $\alpha = 0.00392 \text{ K}^{-1}$	Pt25 ... Pt1000
• to IEC 60751	Ni25 ... Ni1000
• Special type	over special characteristic (max. 30 points)
Sensor factor	0.25 ... 10 (adaptation of the basic type, e.g. Pt100 to version Pt25 ... 1000)
Units	°C or °F
Connection	
• Standard connection	1 resistance thermometer (RTD) in 2-wire, 3-wire or 4-wire system
• Generation of average value	2 identical resistance thermometers in 2-wire system for generation of average temperature
• Generation of difference	2 identical resistance thermometers (RTD) in 2-wire system (RTD 1 – RTD 2 or RTD 2 – RTD 1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	$\leq 0.45 \text{ mA}$
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Always active (cannot be disabled)
Short-circuit monitoring	can be switched on/off (default value: ON)
Measuring range	parameterizable (see table "Digital measuring errors")
Min. measured span	10 °C (18 °F)
Characteristic curve	Temperature-linear or special characteristic

##### Resistance-based sensors

Measured variable	Actual resistance
Sensor type	Resistance-based, potentiometers
Units	$\Omega$
Connection	
• Normal connection	1 resistance-based sensor (R) in 2-wire, 3-wire or 4-wire system
• Generation of average value	2 resistance-based sensors in 2-wire system for generation of average value
• Generation of difference	2 resistance thermometers in 2-wire system (R1 – R2 or R2 – R1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	$\leq 0.45 \text{ mA}$

Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Always active (cannot be disabled)
Short-circuit monitoring	can be switched on/off (default value: OFF)
Measuring range	parameterizable max. 0 ... 2200 $\Omega$ (see table "Digital measuring errors")
Min. measured span	5 $\Omega$ ... 25 $\Omega$ (see Table "Digital measuring errors")
Characteristic curve	Resistance-linear or special characteristic
<b>Thermocouples</b>	
Measured variable	Temperature
Sensor type (thermocouples)	
• Type B	Pt30Rh-Pt6Rh to DIN IEC 584
• Type C	W5 %-Re acc. to ASTM 988
• Type D	W3 %-Re acc. to ASTM 988
• Type E	NiCr-CuNi to DIN IEC 584
• Type J	Fe-CuNi to DIN IEC 584
• Type K	NiCr-Ni to DIN IEC 584
• Type L	Fe-CuNi to DIN 43710
• Type N	NiCrSi-NiSi to DIN IEC 584
• Type R	Pt13Rh-Pt to DIN IEC 584
• Type S	Pt10Rh-Pt to DIN IEC 584
• Type T	Cu-CuNi to DIN IEC 584
• Type U	Cu-CuNi to DIN 43710
Units	°C or °F
Connection	
• Standard connection	1 thermocouple (TC)
• Generation of average value	2 thermocouples (TC)
• Generation of difference	2 thermocouples (TC) (TC1 – TC2 or TC2 – TC1)
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Can be switched off
Cold junction compensation	
• Internal	With integrated Pt100 resistance thermometer
• External	With external Pt100 IEC 60571 (2-wire or 3-wire connection)
• External fixed	Cold junction temperature can be set as fixed value
Measuring range	Parameterizable (see table "Digital measuring errors")
Min. measured span	Min. 40 ... 100 °C (72 ... 180 °F) (see table "Digital measuring errors")
Characteristic curve	Temperature-linear or special characteristic
<b>mV sensor</b>	
Measured variable	DC voltage
Sensor type	DC voltage source (DC voltage source possible over an externally connected resistor)
Units	mV
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Can be switched off
Measuring range	-10 ... +70 mV-100 ... +1100 mV

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH200 two-wire system, universal

Min. measured span	2 mV or 20 mV
Overload capability of the input	-1.5 ... +3.5 V DC
Input resistance	≥ 1 MΩ
Characteristic curve	Voltage-linear or special characteristic
<b>Output</b>	
Output signal	4 ... 20 mA, 2-wire
Auxiliary power	11 ... 35 V DC ((to 30 V for Ex ia and ib; to 32 V for Ex nA / nL / ic)
Max. load	(U <sub>aux</sub> - 11 V)/0.023 A
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.80 mA ... 20.5 mA)
Error signal (e.g. following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default value: 22.8 mA)
Sample cycle	0.25 s nominal
Damping	Software filter 1st order 0 ... 30 s (parameterizable)
Protection	Against reversed polarity
Electrically isolated	Input against output (1 kV <sub>eff</sub> )
<b>Measuring accuracy</b>	
Digital measuring errors	See table "Digital measuring errors"
Reference conditions	
• Auxiliary power	24 V ± 1 %
• Load	500 Ω
• Ambient temperature	23 °C
• Warming-up time	> 5 min
Error in the analog output (digital/analog converter)	< 0.025 % of span
Error due to internal cold junction	< 0.5 °C (0.9 °F)
Influence of ambient temperature	
• Analog measuring error	0.02 % of span/10°C (18 °F)
• Digital measuring errors	
- with resistance thermometers	0.06 °C (0.11 °F)/10°C (18 °F)
- with thermocouples	0.6 °C (1.1 °F)/10°C (18 °F)
Auxiliary power effect	< 0.001 % of span/V
Effect of load impedance	< 0.002 % of span/100 Ω
Long-term drift	
• In the first month	• < 0.02 % of span
• After one year	• < 0.2 % of span
• After 5 years	• < 0.3 % of span
<b>Conditions of use</b>	
<u>Ambient conditions</u>	
Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)
Relative humidity	< 98 %, with condensation
Electromagnetic compatibility	acc. to EN 61326 and NE21
<b>Construction</b>	
Material	Molded plastic
Weight	50 g (0.11 lb)
Dimensions	See "Dimensional drawings"
Cross-section of cables	Max. 2.5 mm <sup>2</sup> (AWG 13)
Degree of protection to IEC 60529	
• Enclosure	IP40
• Terminals	IP00

#### Certificates and approvals

Explosion protection ATEX

EC type test certificate

• "Intrinsic safety" type of protection

• "Operating equipment that is non-ignitable and has limited energy" type of protection

Explosion protection: FM for USA

• FM approval

• Degree of protection

Explosion protection to FM for Canada (cFM<sub>US</sub>)

• FM approval

• Degree of protection

Other certificates

#### Software requirements for SIPROM T

PC operating system

#### Factory setting:

- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

PTB 05 ATEX 2040X

II 1 G Ex ia IIC T6/T4  
II 2 (1) G Ex ia/ib IIC T6/T4  
II 3(1) G Ex ia/ic IIC T6/T4  
II 1D Ex iaD 20 T115 °C

II 3 G Ex nL IIC T6/T4  
II 3 G Ex nA IIC T6/T4

FM 3024169

IS / CI I, II, III / Div 1 / GP  
ABCDEFGH T6, T5, T4  
CI I / ZN 0 / AEx ia IIC T6, T5, T4  
NI / CI I / Div 2 / GP ABCDFG T6, T5, T4  
NI / CI I / ZN 2 / IIC T6, T5, T4

FM 3024169C

IS / CI I, II, III / Div 1 / GP  
ABCDEFGH T6, T5, T4  
NI / CI I / DIV 2 / GP ABCD T6, T5, T4  
NIFW / CI I, II, III / DIV 2 / GP  
ABCDEFGH T6, T5, T4  
DIP / CI II, III / Div 2 / GP FG T6, T5, T4  
CI I / ZN 0 / Ex ia IIC T6, T5, T4  
CI I / ZN 2 / Ex nA nL IIC T6, T5, T4

GOST, NEPSI, PESO, IEC, EXPOLABS

Windows ME, 2000, XP, Win 7 and Win 8; can also be used in connection with RS 232 modem under Windows 95, 98 and 98SE

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH200 two-wire system, universal

#### Digital measuring errors

Resistance thermometer

Input	Measuring range °C / (°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
<b>to IEC 60751</b>					
Pt25	-200 ... +850 (-328 ... +1562)	10	(18)	0,3	(0.54)
Pt50	-200 ... +850 (-328 ... +1562)	10	(18)	0,15	(0.27)
Pt100 ... Pt200	-200 ... +850 (-328 ... +1562)	10	(18)	0,1	(0.18)
Pt500	-200 ... +850 (-328 ... +1562)	10	(18)	0,15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0,15	(0.27)
<b>to JIS C1604-81</b>					
Pt25	-200 ... +649 (-328 ... +1200)	10	(18)	0,3	(0.54)
Pt50	-200 ... +649 (-328 ... +1200)	10	(18)	0,15	(0.27)
Pt100 ... Pt200	-200 ... +649 (-328 ... +1200)	10	(18)	0,1	(0.18)
Pt500	-200 ... +649 (-328 ... +1200)	10	(18)	0,15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0,15	(0.27)
Ni 25 ... Ni1000	-60 ... +250 (-76 ... +482)	10	(18)	0,1	(0.18)

Resistance-based sensors

Input	Measuring range Ω	Min. mea- sured span Ω	Digital accuracy Ω
Resistance	0 ... 390	5	0,05
Resistance	0 ... 2200	25	0,25

#### Thermocouples

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accuracy (°F)
		°C	(°F)	
Type B	0 ... 1820 (32 ... 3308)	100	(180) 2 <sup>1)</sup>	(3.60) <sup>1)</sup>
Type C (W5)	0 ... 2300 (32 ... 4172)	100	(180) 2	(3.60)
Type D (W3)	0 ... 2300 (32 ... 4172)	100	(180) 1 <sup>2)</sup>	(1.80) <sup>2)</sup>
Type E	-200 ... +1000 (-328 ... +1832)	50	(90) 1	(1.80)
Type J	-210 ... +1200 (-346 ... +2192)	50	(90) 1	(1.80)
Type K	-230 ... +1370 (-382 ... +2498)	50	(90) 1	(1.80)
Type L	-200 ... +900 (-328 ... +1652)	50	(90) 1	(1.80)
Type N	-200 ... +1300 (-328 ... +2372)	50	(90) 1	(1.80)
Type R	-50 ... +1760 (-58 ... +3200)	100	(180) 2	(3.60)
Type S	-50 ... +1760 (-58 ... +3200)	100	(180) 2	(3.60)
Type T	-200 ... +400 (-328 ... +752)	40	(72) 1	(1.80)
Type U	-200 ... +600 (-328 ... +1112)	50	(90) 2	(3.60)

<sup>1)</sup> The digital accuracy in the range 0 to 300 °C (32 to 572 °F) is 3 °C (5.4 °F).

<sup>2)</sup> The digital accuracy in the range 1750 to 2300 °C (3182 to 4172 °F) is 2 °C (3.6 °F).

#### mV sensor

Input	Measuring range mV	Min. measured span mV	Digital accuracy μV
mV sensor	-10 ... +70	2	40
mV sensor	-100 ... +1100	20	400

The digital accuracy is the accuracy after the analog/digital conversion including linearization and calculation of the measured value.

An additional error is generated in the output current 4 to 20 mA as a result of the digital/analog conversion of 0.025 % of the set span (digital-analog error).

The total error under reference conditions at the analog output is the sum from the digital error and the digital-analog error (poss. with the addition of cold junction errors in the case of thermocouple measurements).

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH200 two-wire system, universal

Selection and Ordering data	Article No.
<b>Temperature transmitter SITRANS TH200</b> for installation in connection head, type B (DIN 43729), two-wire system, 4 ... 20 mA, programmable, with electrical isolation	
<ul style="list-style-type: none"> <li>• Without explosion protection ▶ ◆ <b>7NG3211-1NN00</b></li> <li>• With explosion protection               <ul style="list-style-type: none"> <li>- to ATEX ▶ ◆ <b>7NG3211-1AN00</b></li> <li>- to FM (cFM<sub>US</sub>) ▶ ◆ <b>7NG3211-1BN00</b></li> </ul> </li> </ul>	
<b>Further designs</b>	Order code
Add <b>"-Z"</b> to Article No. and specify Order code(s)	
With test protocol (5 measuring points)	<b>C11</b>
Functional safety SIL2	<b>C20</b>
Functional safety SIL2/3	<b>C23</b>
<b>Customer-specific programming</b>	
Add <b>"-Z"</b> to Article No. and specify Order code(s)	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	<b>Y01<sup>1)</sup></b>
Measuring point no. (TAG), max. 8 characters	<b>Y17<sup>2)</sup></b>
Measuring point descriptor, max. 16 characters	<b>Y23<sup>2)</sup></b>
Measuring point message, max. 32 characters	<b>Y24<sup>2)</sup></b>
Pt100 (IEC) 2-wire, R <sub>L</sub> = 0 Ω	<b>U02<sup>3)</sup></b>
Pt100 (IEC) 3-wire	<b>U03<sup>3)</sup></b>
Pt100 (IEC) 4-wire	<b>U04<sup>3)</sup></b>
Thermocouple type B	<b>U20<sup>3)4)</sup></b>
Thermocouple type C (W5)	<b>U21<sup>3)4)</sup></b>
Thermocouple type D (W3)	<b>U22<sup>3)4)</sup></b>
Thermocouple type E	<b>U23<sup>3)4)</sup></b>
Thermocouple type J	<b>U24<sup>3)4)</sup></b>
Thermocouple type K	<b>U25<sup>3)4)</sup></b>
Thermocouple type L	<b>U26<sup>3)4)</sup></b>
Thermocouple type N	<b>U27<sup>3)4)</sup></b>
Thermocouple type R	<b>U28<sup>3)4)</sup></b>
Thermocouple type S	<b>U29<sup>3)4)</sup></b>
Thermocouple type T	<b>U30<sup>3)4)</sup></b>
Thermocouple type U	<b>U31<sup>3)4)</sup></b>
With TC: CJC external (Pt100, 3-wire)	<b>U41</b>
With TC: CJC external with fixed value, specify in plain text	<b>Y50</b>
Special differing customer-specific programming, specify in plain text	<b>Y09<sup>5)</sup></b>
Fail-safe value 3.6 mA (instead of 22,8 mA)	<b>U36<sup>2)</sup></b>
Cable extension Transmitter with installed cable extension 200 mm (7.81 inch), for Pt100 in four-wire system	<b>W01</b>

Accessories	Article No.
<b>Modem for SITRANS TH100, TH200, TR200 and TF with TH200 incl. SIPROM T parameterization software</b> ▶ With USB connection	<b>7NG3092-8KU</b>
<b>MiniDVD for temperature measuring instruments</b> ▶ With documentation in German, English, French, Spanish, Italian, Portuguese and SIPROM T parameterization software	<b>A5E00364512</b>
<b>DIN rail adapters for head transmitters</b> ▶ (Quantity delivered: 5 units)	<b>7NG3092-8KA</b>
<b>Connecting cable</b> 4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)	<b>7NG3092-8KC</b>

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 9/5 in the appendix.

- 1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- 2) For this selection, Y01 or Y09 must also be selected.
- 3) For this selection, Y01 must also be selected.
- 4) Internal cold junction compensation is selected as the default for TC.
- 5) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

#### Ordering example 1:

7NG3211-1NN00-Z Y01+Y17+U03  
 Y01: -10 ... +100 °C  
 Y17: TICA123

#### Ordering example 2:

7NG3211-1NN00-Z Y01+Y23+U25  
 Y01: -10 ... +100 °C  
 Y23: TICA1234HEAT

#### Factory setting:


- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH200 two-wire system, universal


#### Dimensional drawings

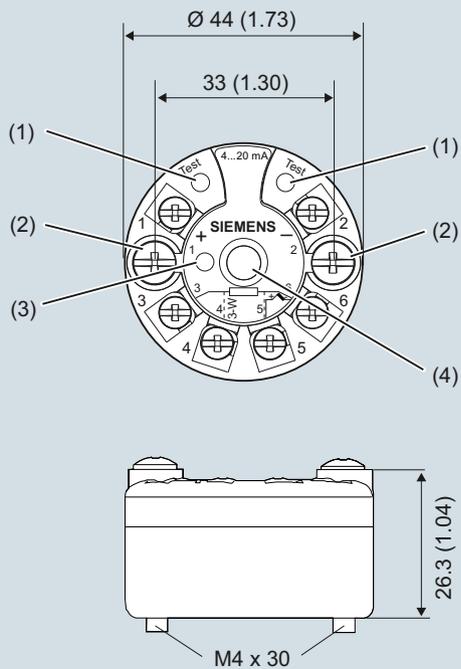


- |           |          |  |
|-----------|----------|--|
| 1(+)      | and 2(-) | Auxiliary power supply $U_{aux}$ , output current $I_{out}$      |
| 3, 4, 5   | and 6    | Pt100 sensor (for connections, see Sensor connection assignment) |
| Test (+), | Test (-) | Measurement of the output current with a multimeter              |
| (1)       |          | Test terminal  |
| (2)       |          | Mounting screw M4x30   |
| (3)       |          | LED for operation indication                                     |
| (4)       |          | Internal diameter of center hole 6.3 (0.25)                      |

SITRANS TH200, dimensions and pin assignment, dimensions in mm (inch)

#### Mounting on DIN rail

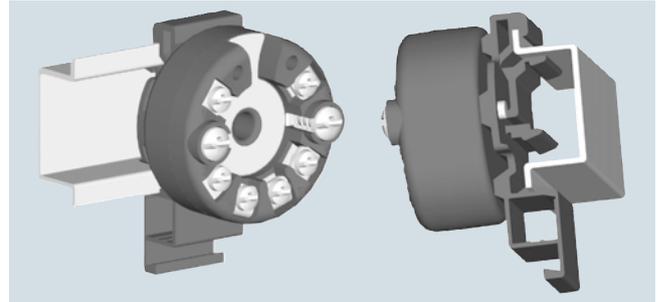

SITRANS TH200, mounting of transmitter on DIN rail

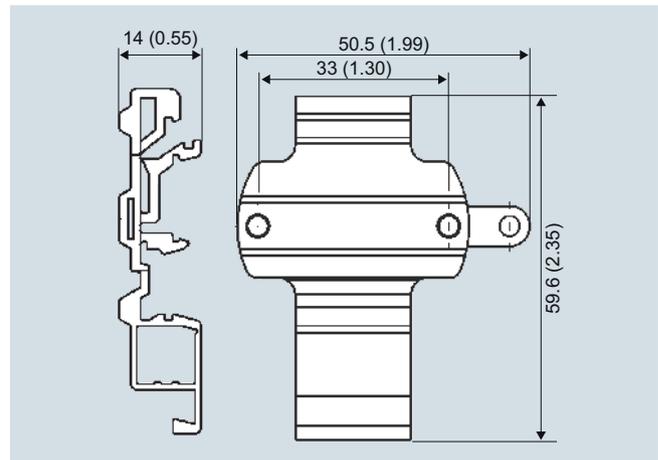


DIN rail adapter, dimensions in mm (inch)


**Schematics**

2


**Resistance thermometer**




Two-wire system <sup>1)</sup>



Three-wire system




Four-wire system




Generation of average value / difference <sup>1)</sup>

<sup>1)</sup> Programmable line resistance for the purpose of correction.


**Resistance**




Two-wire system <sup>1)</sup>



Three-wire system




Four-wire system




Generation of average value / difference <sup>1)</sup>


**Thermocouple**




Cold junction compensation  
Internal/fixed value



Cold junction compensation with  
external Pt100 in two-wire system <sup>1)</sup>




Cold junction compensation with  
external Pt100 in three-wire system




Generation of average value / difference  
with internal cold junction compensation


**Voltage measurement**



**Current measurement**



**Connection of auxiliary power supply (U<sub>aux</sub>)**



SITRANS TH200, sensor connection assignment

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH300 two-wire system, universal, HART

#### Overview



#### "HART" to beat - the universal SITRANS TH300 transmitter

- Two-wire devices for 4 to 20 mA, HART
- Mounting in the connection head of the temperature sensor
- Universal input for virtually any type of temperature sensor
- Configurable over HART

#### Benefits

- Compact design
- Flexible mounting and center hole allow you to select your preferred type of installation
- Electrically isolated
- Test sockets for multimeters
- Diagnostics LED (green/red)
- Sensor monitoring open circuits and short-circuits
- Self-monitoring
- Configuration status stored in EEPROM
- SIL2 (with Order Code C20), SIL2/3 (with C23)
- Expanded diagnostic functions, such as slave pointer, operating hours counter, etc.
- Special characteristic
- Electromagnetic compatibility to EN 61326 and NE21

#### Application

SITRANS TH300 transmitters can be used in all industrial sectors. Due to their compact size they can be installed in the connection head type B (DIN 43729) or larger. The following sensors/signal sources can be connected over their universal input module:

- Resistance thermometers (2, 3 or 4-wire system)
- Thermocouples
- Resistance-based sensors and DC voltage sources

The output signal is a direct current from 4 to 20 mA in accordance with the sensor characteristic, superimposed by the digital HART signal.


Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 94/9/EC (ATEX), as well as FM and CSA regulations.

#### Function

The SITRANS TH300 is configured over HART. This can be done using a handheld communicator or even more conveniently with a HART modem and the SIMATIC PDM parameterization software. The configuration data are then permanently stored in the non-volatile memory (EEPROM).

Once the sensors and power supply have been correctly connected, the transmitter outputs a temperature-linear output signal and the diagnostics LED displays a green light. In the case of a sensor short-circuit, the LED flashes red, an internal device fault is indicated by a steady red light.

The test socket can be used to connect an ammeter at any time for monitoring purposes and plausibility checks. The output current can be read without any interruption, or even without opening the current loop.

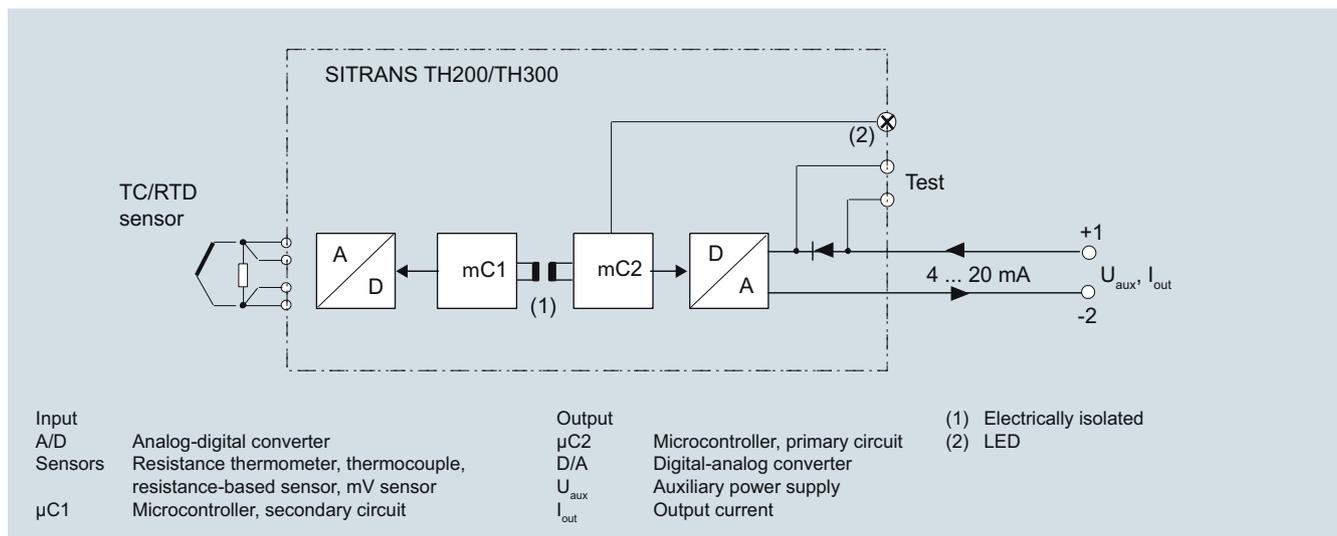

SITRANS TH 300 function diagram

# Temperature Measurement

## Transmitters for mounting in sensor head

### SITRANS TH300 two-wire system, universal, HART

#### Technical specifications

##### Input

##### Resistance thermometer

Measured variable	Temperature
Sensor type	
• to IEC 60751	Pt25 ... Pt1000
• To JIS C 1604; $a = 0.00392 \text{ K}^{-1}$	Pt25 ... Pt1000
• to IEC 60751	Ni25 ... Ni1000
• Special type	over special characteristic (max. 30 points)
Sensor factor	0.25 ... 10 (adaptation of the basic type, e.g. Pt100 to version Pt25 ... 1000)
Units	°C or °F
Connection	
• Standard connection	1 resistance thermometer (RTD) in 2-wire, 3-wire or 4-wire system
• Generation of average value	2 identical resistance thermometers in 2-wire system for generation of average temperature
• Generation of difference	2 identical resistance thermometers (RTD) in 2-wire system (RTD 1 – RTD 2 or RTD 2 – RTD 1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	$\leq 0.45 \text{ mA}$
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Always active (cannot be disabled)
Short-circuit monitoring	can be switched on/off (default value: ON)
Measuring range	parameterizable (see table "Digital measuring errors")
Min. measured span	10 °C (18 °F)
Characteristic curve	Temperature-linear or special characteristic

##### Resistance-based sensors

Measured variable	Actual resistance
Sensor type	Resistance-based, potentiometers
Units	$\Omega$
Connection	
• Normal connection	1 resistance-based sensor (R) in 2-wire, 3-wire or 4-wire system
• Generation of average value	2 resistance-based sensors in 2-wire system for generation of average value
• Generation of difference	2 resistance thermometers in 2-wire system (R1 – R2 or R2 – R1)
Interface	
• Two-wire system	Parameterizable line resistance $\leq 100 \Omega$ (loop resistance)
• Three-wire system	No balancing required
• Four-wire system	No balancing required
Sensor current	$\leq 0.45 \text{ mA}$

Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Always active (cannot be disabled)
Short-circuit monitoring	can be switched on/off (default value: OFF)
Measuring range	parameterizable max. 0 ... 2200 $\Omega$ (see table "Digital measuring errors")
Min. measured span	5 ... 25 $\Omega$ (see table "Digital measuring errors")
Characteristic curve	Resistance-linear or special characteristic
<u>Thermocouples</u>	
Measured variable	Temperature
Sensor type (thermocouples)	
• Type B	Pt30Rh-Pt6Rh to DIN IEC 584
• Type C	W5 %-Re acc. to ASTM 988
• Type D	W3 %-Re acc. to ASTM 988
• Type E	NiCr-CuNi to DIN IEC 584
• Type J	Fe-CuNi to DIN IEC 584
• Type K	NiCr-Ni to DIN IEC 584
• Type L	Fe-CuNi to DIN 43710
• Type N	NiCrSi-NiSi to DIN IEC 584
• Type R	Pt13Rh-Pt to DIN IEC 584
• Type S	Pt10Rh-Pt to DIN IEC 584
• Type T	Cu-CuNi to DIN IEC 584
• Type U	Cu-CuNi to DIN 43710
Units	°C or °F
Connection	
• Standard connection	1 thermocouple (TC)
• Generation of average value	2 thermocouples (TC)
• Generation of difference	2 thermocouples (TC) (TC1 – TC2 or TC2 – TC1)
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	can be switched off
Cold junction compensation	
• Internal	With integrated Pt100 resistance thermometer
• External	With external Pt100 IEC 60571 (2-wire or 3-wire connection)
• External fixed	Cold junction temperature can be set as fixed value
Measuring range	parameterizable (see table "Digital measuring errors")
Min. measured span	Min. 40 ... 100 °C (72 ... 180 °F) (see table "Digital measuring errors")
Characteristic curve	Temperature-linear or special characteristic
<u>mV sensor</u>	
Measured variable	DC voltage
Sensor type	DC voltage source (DC voltage source possible over an externally connected resistor)
Units	mV
Response time	$\leq 250 \text{ ms}$ for 1 sensor with open-circuit monitoring
Open-circuit monitoring	Can be switched off

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH300 two-wire system, universal, HART

Measuring range	-10 ... +70 mV -100 ... +1100 mV
Min. measured span	2 mV or 20 mV
Overload capability of the input	-1.5 ... +3.5 V DC
Input resistance	≥ 1 MΩ
Characteristic curve	Voltage-linear or special characteristic
<b>Output</b>	
Output signal	4 ... 20 mA, 2-wire with communication acc. to HART Rev. 5.9
Auxiliary power	11 ... 35 V DC (to 30 V for Ex ia and ib; to 32 V for Ex nA/nL/ic)
Max. load	(U <sub>aux</sub> - 11 V)/0.023 A
Overrange	3.6 ... 23 mA, infinitely adjustable (default range: 3.80 mA ... 20.5 mA)
Error signal (e.g. following sensor fault) (conforming to NE43)	3.6 ... 23 mA, infinitely adjustable (default value: 22.8 mA)
Sample cycle	0.25 s nominal
Damping	Software filter 1st order 0 ... 30 s (parameterizable)
Protection	Against reversed polarity
Electrically isolated	Input against output (1 kV <sub>eff</sub> )
<b>Measuring accuracy</b>	
Digital measuring errors	See Table "Digital measuring errors"
Reference conditions	
• Auxiliary power	24 V ± 1 %
• Load	500 Ω
• Ambient temperature	23 °C
• Warming-up time	> 5 min
Error in the analog output (digital/analog converter)	< 0.025 % of span
Error due to internal cold junction	< 0.5 °C (0.9 °F)
Influence of ambient temperature	
• Analog measuring error	0.02 % of span/10°C (18 °F)
• Digital measuring errors	
- with resistance thermometers	0.06 °C (0.11 °F)/10°C (18 °F)
- with thermocouples	0.6 °C (1.1 °F)/10°C (18 °F)
Auxiliary power effect	< 0.001 % of span/V
Effect of load impedance	< 0.002 % of span/100 Ω
Long-term drift	
• In the first month	< 0.02 % of span
• After one year	< 0.2 % of span
• After 5 years	< 0.3 % of span
<b>Conditions of use</b>	
<u>Ambient conditions</u>	
Ambient temperature range	-40 ... +85 °C (-40 ... +185 °F)
Storage temperature range	-40 ... +85 °C (-40 ... +185 °F)
Relative humidity	< 98 %, with condensation
Electromagnetic compatibility	acc. to EN 61326 and NE21

<b>Construction</b>	
Material	Molded plastic
Weight	50 g (0.11 lb)
Dimensions	See "Dimensional drawings"
Cross-section of cables	Max. 2.5 mm <sup>2</sup> (AWG 13)
Degree of protection to IEC 60529	
• Enclosure	IP40
• Terminals	IP00
<b>Certificates and approvals</b>	
Explosion protection ATEX	
EC type test certificate	PTB 05 ATEX 2040X
• "Intrinsic safety" type of protection	II 1 G Ex ia IIC T6/T4 II 2 (1) G Ex ia/ib IIC T6/T4 II 3(1) G Ex ia/ic IIC T6/T4 II 1D Ex iaD 20 T115 °C
• "Operating equipment that is non-ignitable and has limited energy" type of protection	II 3 G Ex nL IIC T6/T4 II 3 G Ex nA IIC T6/T4
Explosion protection: FM for USA	
• FM approval	FM 3024169
• Degree of protection	IS / CI I, II, III / Div 1 / GP ABCDEFG T6, T5, T4 CI I / ZN 0 / AEx ia IIC T6, T5, T4 NI / CI I / Div 2 / GP ABCDFG T6, T5, T4 NI / CI I / ZN 2 / IIC T6, T5, T4
Explosion protection to FM for Canada (cFM <sub>US</sub> )	
• FM approval	FM 3024169C
• Degree of protection	IS / CI I, II, III / Div 1 / GP ABCDEFG T6, T5, T4 NI / CI I / DIV 2 / GP ABCD T6, T5, T4 NIFW / CI I, II, III / DIV 2 / GP ABCDEFG T6, T5, T4 DIP / CI II, III / Div 2 / GP FG T6, T5, T4 CI I / ZN 0 / Ex ia IIC T6, T5, T4 CI I / ZN 2 / Ex nA nL IIC T6, T5, T4
Other certificates	GOST, NEPSI, PESO, IEC, EXPOLABS
<b>Factory setting:</b>	
• Pt100 (IEC 751) with 3-wire circuit	
• Measuring range: 0 ... 100 °C (32 ... 212 °F)	
• Fault current: 22.8 mA	
• Sensor offset: 0 °C (0 °F)	
• Damping 0.0 s	

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH300 two-wire system, universal, HART

#### Digital measuring errors

##### Resistance thermometer

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
<b>to IEC 60751</b>					
Pt25	-200 ... +850 (-328 ... +1562)	10	(18)	0,3	(0.54)
Pt50	-200 ... +850 (-328 ... +1562)	10	(18)	0,15	(0.27)
Pt100 ... Pt200	-200 ... +850 (-328 ... +1562)	10	(18)	0,1	(0.18)
Pt500	-200 ... +850 (-328 ... +1562)	10	(18)	0,15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0,15	(0.27)
<b>to JIS C1604-81</b>					
Pt25	-200 ... +649 (-328 ... +1200)	10	(18)	0,3	(0.54)
Pt50	-200 ... +649 (-328 ... +1200)	10	(18)	0,15	(0.27)
Pt100 ... Pt200	-200 ... +649 (-328 ... +1200)	10	(18)	0,1	(0.18)
Pt500	-200 ... +649 (-328 ... +1200)	10	(18)	0,15	(0.27)
Pt1000	-200 ... +350 (-328 ... +662)	10	(18)	0,15	(0.27)
Ni 25 to Ni1000	-60 ... +250 (-76 ... +482)	10	(18)	0,1	(0.18)

##### Resistance-based sensors

Input	Measuring range Ω	Min. mea- sured span Ω	Digital accuracy Ω
Resistance	0 ... 2200	25	0,25

##### Thermocouples

Input	Measuring range °C/(°F)	Min. mea- sured span		Digital accuracy	
		°C	(°F)	°C	(°F)
Type B	0 ... 1820 (32 ... 3308)	100	(180)	2 <sup>1)</sup>	(3.60) <sup>1)</sup>
Type C (W5)	0 ... 2300 (32 ... 4172)	100	(180)	2	(3.60)
Type D (W3)	0 ... 2300 (32 ... 4172)	100	(180)	1 <sup>2)</sup>	(1.80) <sup>2)</sup>
Type E	-200 ... +1000 (-328 ... +1832)	50	(90)	1	(1.80)
Type J	-210 ... +1200 (-346 ... +2192)	50	(90)	1	(1.80)
Type K	-230 ... +1370 (-382 ... +2498)	50	(90)	1	(1.80)
Type L	-200 ... +900 (-328 ... +1652)	50	(90)	1	(1.80)
Type N	-200 ... +1300 (-328 ... +2372)	50	(90)	1	(1.80)
Type R	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.60)
Type S	-50 ... +1760 (-58 ... +3200)	100	(180)	2	(3.60)
Type T	-200 ... +400 (-328 ... +752)	40	(72)	1	(1.80)
Type U	-200 ... +600 (-328 ... +1112)	50	(90)	2	(3.60)

<sup>1)</sup> The digital accuracy in the range 0 to 300 °C (32 to 572 °F) is 3 °C (5.4 °F).

<sup>2)</sup> The digital accuracy in the range 1750 to 2300 (3182 to 4172 °F) is 2 °C (3.6 °F).

##### mV sensor

Input	Measuring range mV	Min. mea- sured span mV	Digital accuracy μV
mV sensor	-100 ... +1100	20	400

The digital accuracy is the accuracy after the analog/digital conversion including linearization and calculation of the measured value.

An additional error is generated in the output current 4 to 20 mA as a result of the digital/analog conversion of 0.025 % of the set span (digital-analog error).

The total error under reference conditions at the analog output is the sum from the digital error and the digital-analog error (poss. with the addition of cold junction errors in the case of thermocouple measurements).

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH300 two-wire system, universal, HART

Selection and Ordering data	Article No.
<b>Temperature transmitter SITRANS TH300</b> for installation in connection head, type B (DIN 43729), two-wire system 4 ... 20 mA, communication capable to HART, with galvanic isolation	
<ul style="list-style-type: none"> <li>• Without explosion protection ▶ ◆ <b>7NG3212-0NN00</b></li> <li>• With explosion protection               <ul style="list-style-type: none"> <li>- to ATEX ▶ ◆ <b>7NG3212-0AN00</b></li> <li>- to FM (C<sub>FMUS</sub>) ▶ ◆ <b>7NG3212-0BN00</b></li> </ul> </li> </ul>	
<b>Further designs</b>	Order code
Add <b>"-Z"</b> to Article No. and specify	
with test protocol (5 measuring points)	<b>C11</b>
Functional safety SIL2	<b>C20</b>
Functional safety SIL2/3	<b>C23</b>
<b>Customer-specific programming</b>	
Add <b>"-Z"</b> to Article No. and specify	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	<b>Y01<sup>1)</sup></b>
Measuring point no. (TAG), max. 8 characters	<b>Y17<sup>2)</sup></b>
Measuring point descriptor, max. 16 characters	<b>Y23<sup>2)</sup></b>
Measuring point message, max. 32 characters	<b>Y24<sup>2)</sup></b>
Pt100 (IEC) 2-wire, R <sub>L</sub> = 0 Ω	<b>U02<sup>3)</sup></b>
Pt100 (IEC) 3-wire	<b>U03<sup>3)</sup></b>
Pt100 (IEC) 4-wire	<b>U04<sup>3)</sup></b>
Thermocouple type B	<b>U20<sup>3)4)</sup></b>
Thermocouple type C (W5)	<b>U21<sup>3)4)</sup></b>
Thermocouple type D (W3)	<b>U22<sup>3)4)</sup></b>
Thermocouple type E	<b>U23<sup>3)4)</sup></b>
Thermocouple type J	<b>U24<sup>3)4)</sup></b>
Thermocouple type K	<b>U25<sup>3)4)</sup></b>
Thermocouple type L	<b>U26<sup>3)4)</sup></b>
Thermocouple type N	<b>U27<sup>3)4)</sup></b>
Thermocouple type R	<b>U28<sup>3)4)</sup></b>
Thermocouple type S	<b>U29<sup>3)4)</sup></b>
Thermocouple type T	<b>U30<sup>3)4)</sup></b>
Thermocouple type U	<b>U31<sup>3)4)</sup></b>
With TC: CJC external (Pt100, 3-wire)	<b>U41</b>
With TC: CJC external with fixed value, specify in plain text	<b>Y50</b>
Special differing customer-specific programming, specify in plain text	<b>Y09<sup>5)</sup></b>
Fail-safe value 3.6 mA (instead of 22,8 mA)	<b>U36<sup>2)</sup></b>
Cable extension Transmitter with installed cable extension 200 mm (7.87 inch), for Pt100 in four-wire system	<b>W01</b>

Accessories	Article No.
<b>MiniDVD for temperature measuring instruments</b> With documentation in German, English, French, Spanish, Italian, Portuguese and SIPROM T parameterization software	<b>A5E00364512</b>
<b>HART modem</b> • With USB connection ▶	<b>7MF4997-1DB</b>
<b>SIMATIC PDM operating software</b>	<b>See Section 8</b>
<b>DIN rail adapters for head transmitters</b> (Quantity delivered: 5 units)	<b>7NG3092-8KA</b>
<b>Connecting cable</b> 4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)	<b>7NG3092-8KC</b>

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 9/5 in the appendix.

- 1) For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- 2) For this selection, Y01 or Y09 must also be selected.
- 3) For this selection, Y01 must also be selected.
- 4) Internal cold junction compensation is selected as the default for TC.
- 5) For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

Supply units see Chapter "Supplementary Components".

#### Ordering example 1:

7NG3212-0NN00-Z Y01+Y17+U03  
 Y01: -10 ... +100 °C  
 Y17: TICA123

#### Ordering example 2:

7NG3212-0NN00-Z Y01+Y23+U25  
 Y01: -10 ... +100 °C  
 Y23: TICA1234HEAT



#### Factory setting:

- Pt100 (IEC 751) with 3-wire circuit
- Measuring range: 0 ... 100 °C (32 ... 212 °F)
- Fault current: 22.8 mA
- Sensor offset: 0 °C (0 °F)
- Damping 0.0 s

## Temperature Measurement Transmitters for mounting in sensor head

SITRANS TH300 two-wire system, universal, HART


### Dimensional drawings

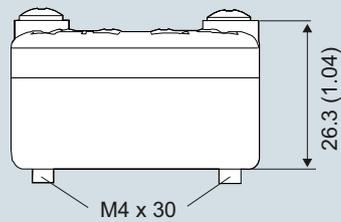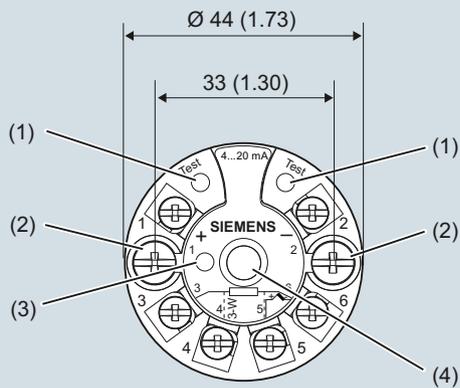


- |           |          |  |
|-----------|----------|--|
| 1(+)      | and 2(-) | Auxiliary power supply $U_{aux}$ , output current $I_{out}$      |
| 3, 4, 5   | and 6    | Pt100 sensor (for connections, see Sensor connection assignment) |
| Test (+), | Test (-) | Measurement of the output current with a multimeter              |
| (1)       |          | Test terminal  |
| (2)       |          | Mounting screw M4x30   |
| (3)       |          | LED for operation indication                                     |
| (4)       |          | Internal diameter of center hole 6.3 (0.25)                      |

SITRANS TH300, dimensions and pin assignment, dimensions in mm (inch)

### Mounting on DIN rail

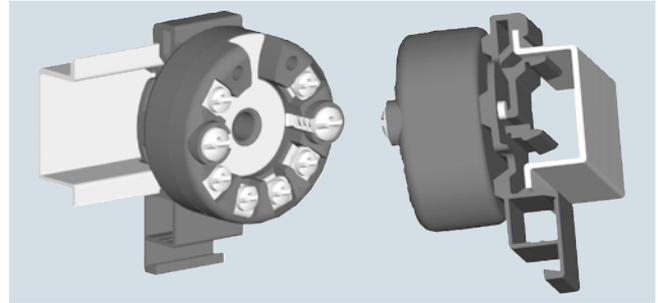

SITRANS TH300, mounting of transmitter on DIN rail

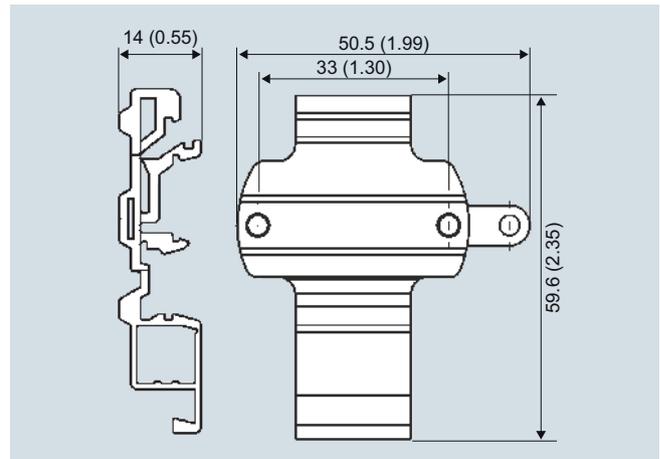

DIN rail adapter, dimensions in mm (inch)

# Temperature Measurement


Transmitters for mounting in sensor head

SITRANS TH300 two-wire system, universal, HART


## Schematics

2


### Resistance thermometer




Two-wire system <sup>1)</sup>



Three-wire system




Four-wire system




Generation of average value / difference <sup>1)</sup>

<sup>1)</sup> Programmable line resistance for the purpose of correction.


### Resistance




Two-wire system <sup>1)</sup>



Three-wire system




Four-wire system




Generation of average value / difference <sup>1)</sup>


### Thermocouple




Cold junction compensation  
Internal/fixed value



Cold junction compensation with  
external Pt100 in two-wire system <sup>1)</sup>




Cold junction compensation with  
external Pt100 in three-wire system




Generation of average value / difference  
with internal cold junction compensation


### Voltage measurement



### Current measurement



### Connection of auxiliary power supply (U<sub>aux</sub>)



SITRANS TH300, sensor connection assignment

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH400 fieldbus transmitter

#### Overview



#### SITRANS TH400 fieldbus transmitters

##### Versions:

- For FOUNDATION fieldbus
- For PROFIBUS PA

The SITRANS TH400 temperature transmitter is a small field bus transmitter for mounting in the connection head of form B. Extensive functionality enables the temperature transmitter to be precisely adapted to the plant's requirements. Operation is very simple in spite of the numerous setting options. Thanks to its universal concept it can be used in all industries and is easy to integrate in the context of Totally Integrated Automation applications.

Transmitters of the "intrinsically safe" type of protection can be installed within potentially explosive atmospheres. The devices comply with the Directive 94/9/EC (ATEX), as well as FM and CSA regulations.

Installing SITRANS TH400 in temperature sensors turns them into complete, bus-capable measuring points; compact - and in a single device.

#### Application

- Linearized temperature measurement with resistance thermometers or thermal elements
- Differential, mean-value or redundant temperature measurement with resistance thermometers or thermal elements
- Linear resistance and bipolar millivolt measurements
- Differential, mean-value or redundant resistance and bipolar millivolt measurements

#### Function

##### Features

- Mounting in connection head, type B, to DIN 43729, or larger
- Polarity-neutral bus connection
- 24-bit analog-digital converter for high resolution
- Electrically isolated
- Intrinsically-safe version for use in potentially explosive areas
- Special characteristic
- Sensor redundancy

##### With PROFIBUS PA communication

- Function blocks: 2 x analog


##### With FOUNDATION fieldbus communication

- Function blocks: 2 x analog and 1 x PID
- Functionality: Basic or LAS

##### Mode of operation

The following function diagram explains the mode of operation of the transmitter.

The only difference between the two versions of the SITRANS TH400 (7NG3214-... and 7NG3215-...) is the type of fieldbus protocol used (PROFIBUS PA or FOUNDATION fieldbus).

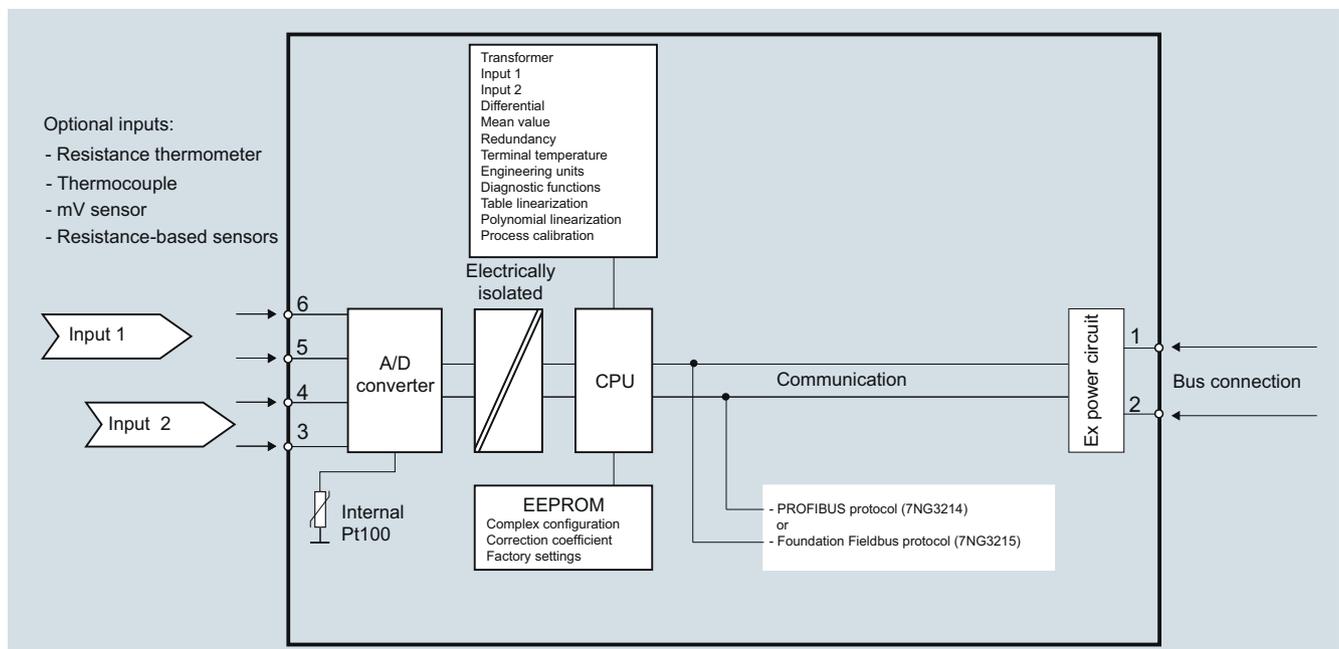


SITRANS TH400, function diagram

## Temperature Measurement

Transmitters for mounting in sensor head

### SITRANS TH400 fieldbus transmitter

#### System communication

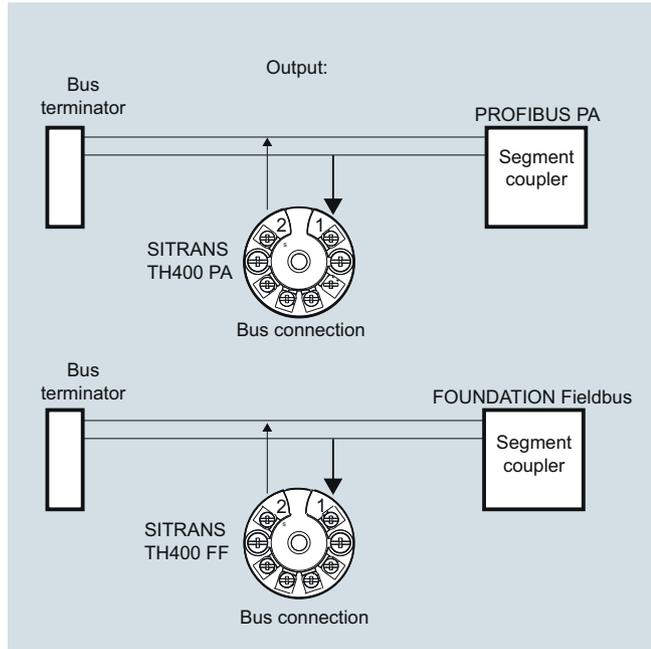

SITRANS TH400, communication interface

#### Technical specifications

##### Input

Analog-to-digital conversion

- Measurement rate < 50 ms
- Resolution 24-bit

Resistance thermometer

Pt25 ... Pt1000 to IEC 60751/JIS C 1604

- Measuring range -200 ... +850 °C (-328 ... +1562 °F)

Ni25 ... Ni1000 to DIN 43760

- Measuring range -60 ... +250 °C (-76 ... +482 °F)

Cu10 ... Cu1000,  $\alpha = 0.00427$

- Measuring range -50 ... +200 °C (-58 ... +392 °F)

Line resistance per sensor cable

Max. 50  $\Omega$

Sensor current

Nominal 0.2 mA

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 15  $\Omega$

Resistance-based sensors

Measuring range 0  $\Omega$  ... 10 k $\Omega$

Line resistance per sensor cable

Max. 50  $\Omega$

Sensor current

Nominal 0.2 mA

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 15  $\Omega$

##### Thermocouple

to IEC 584

- Type B
- Type E
- Type J
- Type K
- Type N
- Type R
- Type S
- Type T

to DIN 43710

- Type L
- Type U

to ASTM E988-90

- Type W3 0 ... 2300 °C (32 ... +4172 °F)
- Type W5 0 ... 2300 °C (32 ... +4172 °F)

External cold junction compensation -40 ... +135 °C (-40 ... +275 °F)

Sensor fault detection

- Sensor break detection Yes
- Sensor short-circuit detection Yes, < 3 mV
- Sensor current in the event of open-circuit monitoring 4  $\mu$ A

##### mV sensor - voltage input

Measuring range -800 ... +800 mV

Input resistance 10 M $\Omega$

##### Output

Filter time (programmable) 0 ... 60 s

Update time < 400 ms

##### Measuring accuracy

Accuracy is defined as the higher value of general values and basic values.

##### General values

Type of input

All

Absolute accuracy

$\leq \pm 0.05$  % of the measured value

Temperature coefficient

$\leq \pm 0.002$  % of the measured value/°C

##### Basic values

Type of input

Pt100 and Pt1000

Basic accuracy

$\leq \pm 0.1$  °C

Temperature coefficient

$\leq \pm 0.002$  °C/°C

Ni100

$\leq \pm 0.15$  °C

$\leq \pm 0.002$  °C/°C

Cu10

$\leq \pm 1.3$  °C

$\leq \pm 0.02$  °C/°C

Resistance-based sensors

$\leq \pm 0.05$   $\Omega$

$\leq \pm 0.002$   $\Omega$ /°C

Voltage source

$\leq \pm 10$   $\mu$ V

$\leq \pm 0.2$  %  $\mu$ V/°C

Thermocouple, type: E, J, K, L, N, T, U

$\leq \pm 0.5$  °C

$\leq \pm 0.01$  °C/°C

Thermocouple, type: B, R, S, W3, W5

$\leq \pm 1$  °C

$\leq \pm 0.025$  °C/°C

Cold junction compensation

$\leq \pm 0.5$  °C

##### Reference conditions

Warming-up time

30 s

Signal-to-noise ratio

Min. 60 dB

Calibration condition

20 ... 28 °C (68 ... 82 °F)

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH400 fieldbus transmitter

<b>Conditions of use</b> <u>Ambient conditions</u> Permissible ambient temperature -40 ... +85 °C (-40 ... +185 °F) Permissible storage temperature -40 ... +85 °C (-40 ... +185 °F) Relative humidity ≤ 98 %, with condensation Insulation resistance • Test voltage 500 V AC for 60 s Mechanical testing • Vibrations (DIN class B) to IEC 60068-2-6 and IEC 60068-2-64 4 g/2 ... 100 Hz <u>Electromagnetic compatibility</u> EMC noise voltage influence < ± 0.1 % of span Extended EMC noise immunity: NAMUR NE 21, criterion A, Burst < ± 1 % of span EMC 2004/108/EC Emission and Noise Immunity to EN 61326		<b>Certificates and approvals</b> Explosion protection ATEX EC type test certificate • "Intrinsic safety" type of protection EC type test certificate • Type of protection for "equipment is non-arcing" Explosion protection: FM for USA • FM approval • Degree of protection Explosion protection CSA for Canada • CSA approval • Degree of protection Other certificates		KEMA 06 ATEX 0264 II 1 G Ex ia IIC T4...T6 II 2(1) G Ex ib[ia] IIC T4...T6 II 1 D Ex iaD KEMA 06 ATEX 0263 X II 3 GD Ex nA[nL] IIC T4...T6 II 3 GD Ex nL IIC T4...T6 II 3 GD Ex nA[ic] IIC T4...T6 II 3 GD Ex ic IIC T4...T6 FM 3027985 • IS Class I, Div 1, Groups A, B, C, D T4/T5/T6, FISCO • IS Class I, Zone 0, AEx ia, IIC T4/T5/T6, FISCO • NI Class I, Div 2, Groups A, B, C, D T4/T5/T6, FNICO CSA 1861385 • IS Class I, Div 1, Groups A, B, C, D T4/T5/T6 • Ex ia IIC T4/T5/T6 and Ex ib [ia] IIC T4/T5/T6 • NI Class I, Div 2, Groups A, B, C, D T4/T5/T6 • Ex nA II T4/T5/T6 GOST, PESO	
<b>Construction</b> Material Molded plastic Weight 55 g (0.12 lb) Dimensions See Dimensional drawings Cross-section of cables Max. 2.5 mm <sup>2</sup> (AWG 13) Degree of protection • Transmitter enclosure IP40 • Terminal IP00		<b>Communication</b> Parameterization interface • PROFIBUS PA connection - Protocol - Address (for delivery) • FOUNDATION fieldbus connection - Protocol - Functionality - Version - Function blocks		Profile 3.0 126 FF protocol Basic or LAS ITK 4.6 2 x analog and 1 x PID	
<b>Auxiliary power</b> Power supply • Standard, Ex "nA", Ex "nL", NI 9.0 ... 32 V DC • ATEX, FM, UL and CSA 9.0 ... 30 V DC • In FISCO/FNICO installations 9.0 ... 17.5 V DC Power consumption < 11 mA Max. increase in power consumption in the event of a fault < 7 mA		<b>Factory setting</b> <u>only for SITRANS TH400 PA</u> Sensor Pt100 (IEC) Type of connection 3-wire circuit Unit °C Failure mode Last valid value Filter time 0 s PA address 126 PROFIBUS Ident No. Manufacturer-specific <u>only for SITRANS TH400 FF</u> Sensor Pt100 (IEC) Type of connection 3-wire circuit Unit °C Failure mode Last valid value Filter time 0 s Node address 22			

## Temperature Measurement

### Transmitters for mounting in sensor head

#### SITRANS TH400 fieldbus transmitter

Selection and Ordering data	Article No.
<b>Temperature transmitter SITRANS TH400</b> for installation in connection head, with electrical isolation, order operating instructions separately.	
<ul style="list-style-type: none"> <li>Bus-compatible to PROFIBUS PA               <ul style="list-style-type: none"> <li>No explosion protection or Zone 2/Div 2 to ATEX/FM/CSA/IECEX/NEPSI ▶ ◆ <b>7NG3214-0NN00</b></li> <li>With explosion protection "Intrinsically safe to ATEX/FM/CSA/IECEX/NEPSI" ▶ ◆ <b>7NG3214-0AN00</b></li> </ul> </li> <li>Bus-compatible to FOUNDATION Fieldbus               <ul style="list-style-type: none"> <li>No explosion protection or Zone 2/Div 2 to ATEX/FM/CSA/IECEX/NEPSI ▶ ◆ <b>7NG3215-0NN00</b></li> <li>With explosion protection "Intrinsically safe to ATEX/FM/CSA/IECEX/NEPSI" ▶ ◆ <b>7NG3215-0AN00</b></li> </ul> </li> </ul>	
<b>Further designs</b> Please add "-Z" to Article No. and specify Order code(s) and plain text.	Order code
With test protocol (5 measuring points)	<b>C11<sup>1)</sup></b>
<b>Customer-specific programming</b> Add "-Z" to Article No. and specify Order code(s)	
Measuring range to be set Specify in plain text (max. 5 digits): Y01: ... to ... °C, °F	<b>Y01<sup>1)</sup></b>
Measuring point no. (TAG), max. 32 characters	<b>Y17<sup>2)</sup></b>
Measuring point descriptor, max. 32 characters	<b>Y23<sup>2)</sup></b>
Measuring point message, max. 32 characters	<b>Y24<sup>2)</sup></b>
Bus address, specify in plain text	<b>Y25<sup>2)</sup></b>
Pt100 (IEC) 2-wire, $R_L = 0 \Omega$	<b>U02<sup>3)</sup></b>
Pt100 (IEC) 3-wire	<b>U03<sup>3)</sup></b>
Pt100 (IEC) 4-wire	<b>U04<sup>3)</sup></b>
Thermocouple type B	<b>U20<sup>3)4)</sup></b>
Thermocouple type C (W5)	<b>U21<sup>3)4)</sup></b>
Thermocouple type D (W3)	<b>U22<sup>3)4)</sup></b>
Thermocouple type E	<b>U23<sup>3)4)</sup></b>
Thermocouple type J	<b>U24<sup>3)4)</sup></b>
Thermocouple type K	<b>U25<sup>3)4)</sup></b>
Thermocouple type L	<b>U26<sup>3)4)</sup></b>
Thermocouple type N	<b>U27<sup>3)4)</sup></b>
Thermocouple type R	<b>U28<sup>3)4)</sup></b>
Thermocouple type S	<b>U29<sup>3)4)</sup></b>
Thermocouple type T	<b>U30<sup>3)4)</sup></b>
Thermocouple type U	<b>U31<sup>3)4)</sup></b>
With TC: CJC external (Pt100, 3-wire)	<b>U41</b>
With TC: CJC external with fixed value, specify in plain text	<b>Y50</b>
Special differing customer-specific programming, specify in plain text	<b>Y09<sup>5)</sup></b>

Accessories	Article No.
<b>MiniDVD for temperature measuring instruments</b> ▶	<b>A5E00364512</b>
With documentation in German, English, French, Spanish, Italian, Portuguese and SIPROM T parameterization software	
<b>SIMATIC PDM operating software</b>	<b>See Chapter 8</b>
<b>DIN rail adapters for head transmitters</b> (Quantity delivered: 5 units)	<b>7NG3092-8KA</b>
<b>Connecting cable</b> 4-wire, 150 mm, for sensor connections when using head transmitters in the high hinged cover (set with 5 units)	<b>7NG3092-8KC</b>
for additional PA components	<b>See Catalog IK PI</b>

▶ Available ex stock.

◆ We can offer shorter delivery times for configurations designated with the Quick Ship Symbol ◆. For details see page 9/5 in the appendix.

- For customer-specific programming for RTD and TC, the start value and the end value of the required measuring span must be specified here.
- For this selection, Y01 or Y09 must also be selected.
- For this selection, Y01 must also be selected.
- Internal cold junction compensation is selected as the default for TC.
- For customer-specific programming, for example mV and ohm, the start value and the end value of the required measuring span and the unit must be entered here.

#### Ordering example 1:

7NG3214-0NN00-Z Y01+Y17+U03  
 Y01: 0...100 °C  
 Y17: TICA1234HEAT


#### Ordering example 2:

7NG3214-0NN00-Z Y01+Y17+Y25+U25  
 Y01: 0...500 °C  
 Y17: TICA5678HEAT  
 Y25: 33

#### Factory setting:


- For SITRANS TH400 PA:
  - Pt100 (IEC 751) with 3-wire circuit
  - Unit: °C
  - Failure mode: Last valid value
  - Filter time: 0 s
  - PA address: 126
  - PROFIBUS Ident No.: Manufacturer-specific
- For SITRANS TH400 FF:
  - Pt100 (IEC 751) with 3-wire circuit
  - Unit: °C
  - Failure mode: Last valid value
  - Filter time: 0 s
  - Node address: 22

### Dimensional drawings

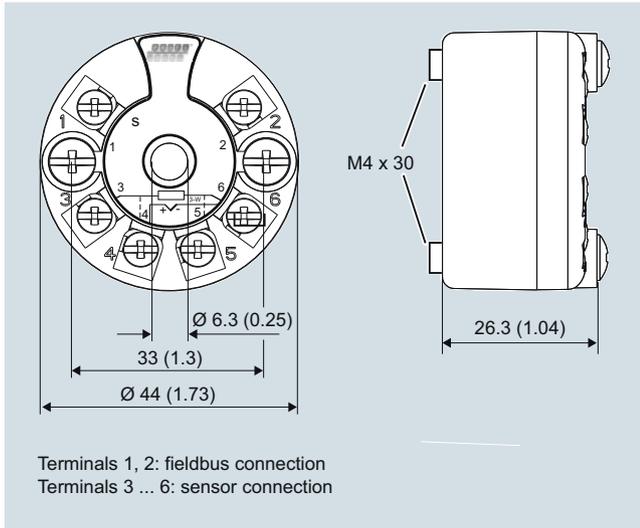


SITRANS TH400 dimensions in mm (inches) and connections

### Mounting on DIN rail

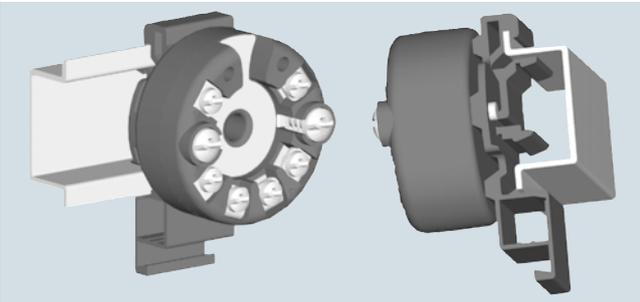

SITRANS TH400, mounting of transmitter on DIN rail

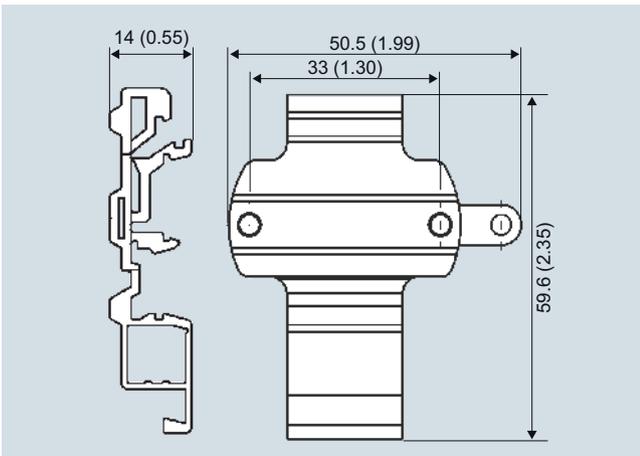

DIN rail adaptor, dimensions in mm (inch)

# Temperature Measurement


Transmitters for mounting in sensor head

## SITRANS TH400 fieldbus transmitter


### Schematics

2


#### Resistance thermometer




Two-wire system <sup>1)</sup>




Three-wire system



Four-wire system




Mean-value/differential or redundancy generation 2 x two-wire system <sup>1)</sup>




Mean-value/differential or redundancy generation 1 sensor in two-wire system <sup>1)</sup>  
1 sensor in three-wire system


#### Thermocouple




Internal cold junction compensation




Cold junction compensation with external Pt100 in two-wire system <sup>1)</sup>



Cold junction compensation with external Pt100 in three-wire system




Mean value, differential or redundancy generation with internal cold junction compensation




Mean value, differential or redundancy generation and cold junction compensation with internal Pt100 in two-wire system <sup>1)</sup>


#### Resistance




Two-wire system <sup>1)</sup>



Three-wire system




Four-wire system




Mean value, differential or redundancy generation 1 resistor in two-wire system <sup>1)</sup>  
1 resistor in three-wire system

#### Voltage measurement



One voltage source



Measurement of mean value, differential and redundancy with 2 voltage sources

<sup>1)</sup> Programmable line resistance for the purpose of correction.